



**HAL**  
open science

## Symmetric Components for Transient Regime Application in MV Systems

Wan-Ying Huang, Robert Kaczmarek

► **To cite this version:**

Wan-Ying Huang, Robert Kaczmarek. Symmetric Components for Transient Regime Application in MV Systems. IPST 2007, 2007, Lyon, France. pp.1-4. hal-00242531

**HAL Id: hal-00242531**

**<https://hal-centralesupelec.archives-ouvertes.fr/hal-00242531>**

Submitted on 6 Feb 2008

**HAL** is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.

# Symmetric Components for Transient Regime Application in MV Systems

Wan-Ying Huang and Robert Kaczmarek

**Abstract--** In order to apply advantageously the symmetrical components theory to SLG fault transients in distribution systems we take profit of similitude of transient components in faulty phase current and in zero sequence current on faulty feeder. Then we are able to take into account the load current contribution within voltage drop account of zero sequence equivalent circuit. The result is an Extended Zero Sequence circuit, of better accuracy comparing to Traditional Zero Sequence circuit or Full Sequence 0-p-n circuit. It presents accurately enough a MV system response to an SLG fault occurrence, whereas traditional equivalent circuits assume only one frequency analysis. Consequently, the new zero sequence circuit is more adapted for evaluation of amplitudes of actual transients or for fault location tasks.

**Index Terms—**power distribution lines, power cables, fault diagnosis, fault location, equivalent circuits

## I. INTRODUCTION

Symmetrical component theory has been for decades a successful approach in power system fault analysis [1], with negative sequence and zero sequence quantities used for relaying. A special challenge is its application to the still unresolved problem of an SLG fault location in distribution networks. The problem is fundamental, as an analysis based on symmetrical components assumes only steady state and single frequency phenomena, either for fundamental frequency or an extracted salient component of charging currents called “main frequency” component. This orientation, denying access to useful fault information contained in transient waveforms, limits efficiency of equivalent circuits in evaluation of transients and in fault location procedures.

For almost two decades two Single Frequency approaches in full sequence 0-p-n equivalent circuit have been studied for fault location task: the method exploiting Main Frequency of charging components [2-5] and the one which uses Rated Frequency component [2, 4, 6]. The simulation results were reported satisfactory for small value of fault resistance.

Not more successful were other location procedures, like the method based on iterative identification of faulty section followed by application of current pattern rules [7], another one using recursive least squares approach [8], an artificial neural networks [9], wavelet, ANN and differential equation [10] or least squares fitting [11]. None of these methods reached beyond 50Ω fault resistance value.

One of reasons may have been lack of truly equivalent circuit capable to reproduce adequate response to fault inception voltage both in transient and in steady state. The

principal problem here is with supply voltage, which in case of the zero sequence circuit should be the pre-fault voltage in the fault occurrence point. This voltage, that we call inception one, often cited in literature [12] has never been given an analytical form and usually is replaced by secondary transformer voltage, with intention to assure zero sequence voltage over the parallel branch carrying zero sequence currents (Fig. 2). The proper calculation of this voltage is a topological challenge, because it depends on taking into account the faulty phase current contribution in zero sequence overall voltage drop account, what seems rather contradictory.

We have solved this difficulty by integrating this contribution not explicitly, but as a correction factor in the input voltage. Thus this voltage is given an analytical form without altering the zero sequence current paths.

The new circuit is an extended Zero Sequence Circuit. It presents better performances than any of equivalent networks in use, both in terms of waveforms equivalence and the fault parameter’s range in location procedures.

## II. DEVELOPMENT

We consider a radial network (**Fig. 1**) supplied by a generator through a delta – star transformer grounded with Petersen coil (PC). A single line-to-ground (SLG) fault through a resistance  $R_f$  is installed on one of the feeders at the distance  $l_f$  from busbar on the phase 3.

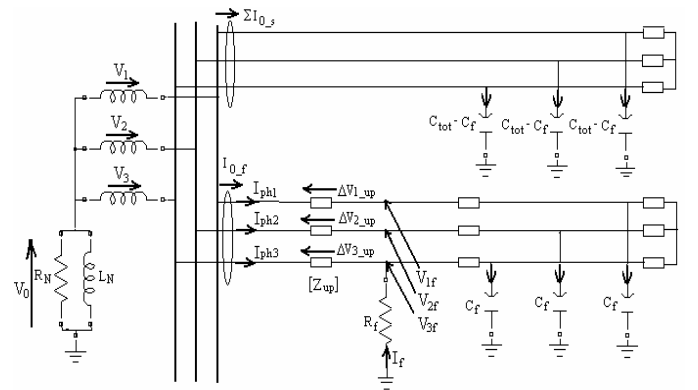


Fig. 1. A phase-to-ground fault in a radial network, all the sound feeders aggregated in one

The traditional zero sequence representation comprises the zero sequence branch in series with the faulty current branch supplied by the secondary transformer voltage, most of the times with line impedances neglected.

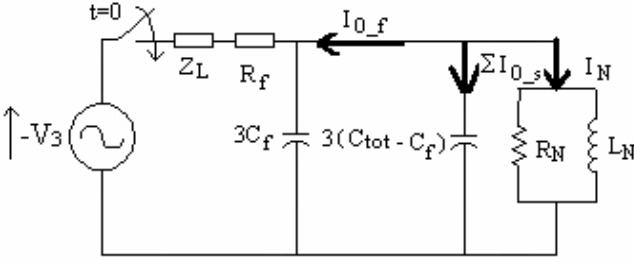


Fig. 2 Traditional equivalent circuit

It can produce good transient response for weak fault resistance values and with the fault located near busbar. Otherwise the equivalence is always poor even if the faulty segment from the fault to busbar is included in series with  $R_f$  (Fig. 2).

#### A. Steady state fault regime

With fault on phase 3 we take this phase as reference (1)

$$|V_3, V_1, V_2|_T = V |I, a^2 a|_T \quad (1)$$

and the equation system for the network of the Fig. 1 has the form (2)

$$\begin{bmatrix} V_{f3} \\ V_{f1} \\ V_{f2} \end{bmatrix} = \begin{bmatrix} -R_f I_f \\ V_{f1} \\ V_{f2} \end{bmatrix} = V_0 \begin{bmatrix} I \\ I + V a^2 \\ I \\ a \end{bmatrix} - \begin{bmatrix} Z_{up} \\ I_{ph3} \\ I_{ph1} \\ I_{ph2} \end{bmatrix} \quad (2)$$

where the symbols are:  $V_{fk}$  phase to ground voltage on fault emplacement for the  $k$ -th phase,  $V_0$  – on Petersen coil,  $V_k$  – on the  $k$ -th transformer secondary winding,  $Z_{up}$  is the matrix of the up-stream line impedances and  $I_{phk}$  is the  $k$ -th phase steady state current in system with fault.

The voltages  $V_k$  are considered the same before and after fault occurrence, in other words the influence of the fault on the internal voltage drops in sources is neglected.

The phase currents on phase 1 and 2 are composed of load and capacitive current, whereas  $I_{ph3}$  is the sum of load, capacitive and fault currents. The latter can be decomposed to get explicitly the fault current  $I_f$ :

$$I_{ph3} = (I_{ph3} - I_{of}) + I_{of} = (I_{ph3} - I_{of}) + j\omega 3C_f V_0 - I_f \quad (3)$$

We note

$$I'_{ph3} = I_{ph3} - I_{of} \quad (4)$$

and get in the symmetric components domain

$$\begin{bmatrix} V_{fp} \\ V_{fn} \\ V_{f0} \end{bmatrix} = V_0 \begin{bmatrix} 0 \\ 0 \\ 1 \end{bmatrix} + V \begin{bmatrix} 1 \\ 0 \\ 0 \end{bmatrix} - \begin{bmatrix} Z_{up-p} & & \\ & Z_{up-n} & \\ & & Z_{up-0} \end{bmatrix} \left\{ \begin{bmatrix} I'_{ph3} + j\omega 3C_f V_0 \\ I_{ph1} \\ I_{ph2} \end{bmatrix} - \frac{I_f}{3} \begin{bmatrix} 1 \\ 1 \\ 1 \end{bmatrix} \right\} \quad (5)$$

where the Fortescue transformation matrix  $T$  is

$$T = \begin{bmatrix} 1 & 1 & 1 \\ a^2 & a & 1 \\ a & a^2 & 1 \end{bmatrix} \quad (6)$$

When getting back to the phase referential by left-multiplying the equation (5) by  $T$ , we obtain (7)

$$V_{3f} = V_3 - E + Z_{up-s} I_f + kV_0 \quad (7)$$

with the correction component of the supply voltage

$$E = \begin{bmatrix} Z_{up-p} \\ Z_{up-n} \\ Z_{up-0} \end{bmatrix}_T \begin{bmatrix} 1 & 1 & 1 \\ a^2 & a & 1 \\ a & a^2 & 1 \end{bmatrix} \begin{bmatrix} I'_{ph3} \\ I_{ph1} \\ I_{ph2} \end{bmatrix} \quad (8)$$

the capacitive correction factor

$$k = 1 - Z_{up-s} j\omega 3C_f \quad (9)$$

where the up-stream self impedance is

$$Z_{up-s} = \frac{1}{3} (Z_{p-up} + Z_{n-up} + Z_{0-up}) \quad (10)$$

The voltage  $V_{f3}$  in (7) can be expressed (Fig. 1) by  $V_{f3} = R_f (-I_f)$  and then the (7) becomes

$$V_0 = \frac{-V_3 + E}{k} - \left[ \frac{R_f}{k} + \frac{Z_{s-up}}{k} \right] I_f \quad (11)$$

This equation is structurally the same as the one representing the traditional zero sequence equivalent circuit (Fig. 2):

$$V_0 = -V_3 - R_f I_f \quad (12)$$

with the zero sequence voltage  $V_0$  and the fault current  $I_f$  supplying the zero sequence branch of Petersen coil and the zero sequence capacitances in parallel. In the new equivalent circuit the fault position is taken into account twice: through the correction component  $E/k$  of the supply voltage (accounting for the role of the symmetric up-stream impedances) and explicitly through the upstream self impedance in the fault current branch.

In usual conditions the coefficient  $k$  can be associated to 1, as the up-stream self impedance is always very weak comparing to that of the capacitive reactance of the faulty feeder. For a network e.g. of 8 line feeders, 30km each, fault

location near loads and distributed line parameters  $C_p=0.14\mu\text{F}$  and  $Z_p=(0.198+j0.325)\Omega/\text{km}$  the value is  $1-(3\cdot 10^{-3} + j10^{-3}) \cong 1$ . This leads to simple form of the extended zero sequence circuit (Fig. 3) with inception voltage

$$V_{inc} = -V_3 + E \quad (13)$$

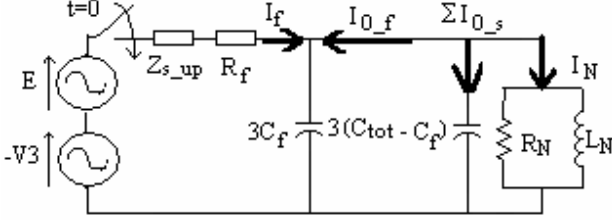


Fig. 3 The new extended zero sequence equivalent circuit

In order to construct the new equivalent circuit we need to know the transformer secondary voltage before the fault occurrence, three phase currents on the faulty feeder, actual tuning and symmetric distributed line impedances. The calculated inception voltage  $(-V_3+E)$  is very near the simulated value on EMTP complete system model (Tab.1).

TABLE I

INCEPTION VOLTAGE SIMULATED IN FULL EMTP MODEL VS THE EQUATION-BASED VALUES (THE CAPACITIVE COMPONENT NOT CORRECTED)

Fault position	0	0.5	1
Inception voltage [V] as in equation (13)	5507	5183	4874
Inception voltage [V] simulated	5507	5209	4932
Error [%]	0	+0.5	+1

### B. Transient regime

Once the inception voltage properly calculated, the circuit will reproduce transient regimes upon its switching-on at inception moment. The equivalence is much better than that on traditional circuit (Fig. 4), permitting good evaluation of charging currents' amplitudes.

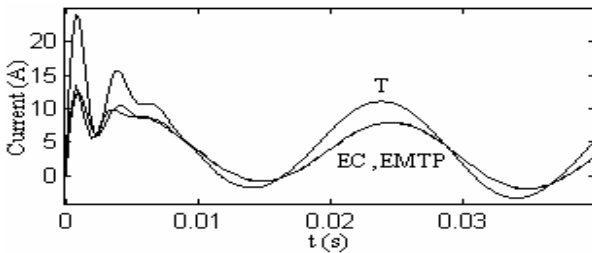


Fig. 4 Faulty residual current from the full EMTP circuit and from its equivalent circuits: the traditional zero sequence circuit (T) and the extended one (EC), in a 10kV network of 8 feeders (22.5+24+26+28+32+34+36+37.5)km, tuning 100%, total loads 10MVA and  $R_f=50\Omega$  at 0.8 of the 37.5km feeder's length.

The zero sequence current on the faulty feeder  $I_{0_f}$  is dominated by the faulty current  $I_f$  (Fig. 5).

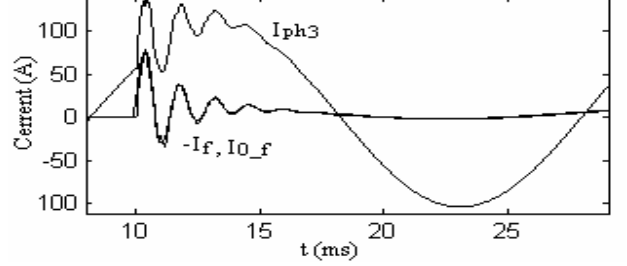


Fig. 5  $(-I_f)$ ,  $I_{ph3}$  and  $I_{0_f}$  in a low resistance phase-to-ground fault in a radial network

The zero sequence current being easily measurable, we use it to get a quasi-sinusoidal component  $I'_{ph3}$  (4) out of the faulty phase transient current. This component is very close to the pre-fault phase current on the faulty phase (Fig. 6) particularly on low capacitive lines and at heavy loads.

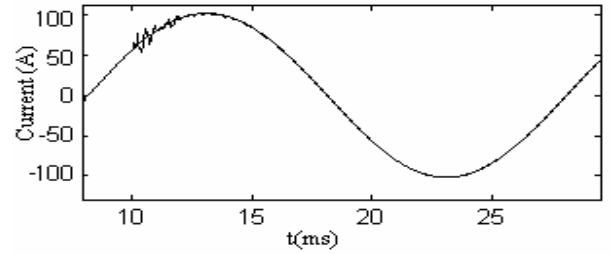


Fig. 6 The pre-fault current on the faulty phase reconstructed out of the after-fault faulty phase current :  $(I_{ph3}-I_{0_f})$  vs. the original pre-fault current

With zero sequence capacitance the corresponding time constants are very short and the capacitive currents can be rapidly taken as sinusoidal. If on the other hand the fault resistance is not too high, then the zero sequence voltage also takes rapidly sinusoidal form.

Then the right side of the equation system is quasi-sinusoidal and the system (14) can be reasonably treated with Fortescue transformation, with its right side transformed explicitly when multiplied by  $T^{-1}$ :

$$T^{-1} \begin{pmatrix} -R_f I_f - \Delta V_f \\ V_{f1} \\ V_{f2} \end{pmatrix} = T^{-1} \left( V_0 \begin{pmatrix} I \\ I \\ I \end{pmatrix} + V \begin{pmatrix} a^2 \\ a \\ a \end{pmatrix} - [Z_{up}] \begin{pmatrix} I'_{ph3} + j\omega 3C_f V_0 \\ I_{ph1} \\ I_{ph2} \end{pmatrix} \right) \quad (14)$$

with both voltage drops of the fault current associated, the first over fault resistance  $-R_f I_f$  and the second over upstream impedance  $\Delta V_f$ .

When getting back to phase coordinates, the left side, without being transformed explicitly, presents voltage drop over the faulty current branch  $(R_f + Z_{up})$  carrying the faulty current  $I_f$ , whereas the right side completes the extended zero sequence circuit by the inception voltage  $-(V_3 - E)$  and the zero sequence branch  $kV_0$ .

The assumption of quasi-sinusoidal nature of (14) is pertinent only under conditions mentioned above. As a consequence, the equivalence of circuit issued out of this analysis will be assured in shorter range of fault resistance in cable systems comparing to that in overhead lines.

### III. NEW CIRCUIT TO FAULT LOCATION

The extended zero sequence circuit has been applied in a three parameters least squares minimization problem, where the actual fault resistance  $R_f$ , fault position  $l_f$  and inception angle  $\theta$  are given by the equivalent circuit's best fitting curve, with EMTP currents taken for reference data. The fitting uses data of transient fault regime. The EMTP currents are calculated with frequency dependant parameters. For robustness reasons the Levenberg – Marquart algorithms is adopted with a modifiable positive term  $\mu_k I$  added to diagonal Hessian matrix.

At each iteration the output parameters are under a fulfilment test, satisfied in proximity of the requested minimum of minimization function at confirmation that the next calculation step involves less than 10% variation of  $R_f$ , 1% variation of  $l_f$  and  $0.2^\circ$  variation of inception angle. As the optimization constraints we have  $R_f > 0$  and  $0 < l_f < 1$  (relative values).

The algorithm has been tested on overhead and cable line radial networks with a SLG fault. In an eight feeders line system of lengths (22.5+24+26+28+32+34+36+37.5)km, at 95...105% tuning, inception angles from  $0^\circ$  to  $90^\circ$ , 10MVA total load and the fault resistance up to 3k $\Omega$  we have got the fault position with less than 10% mean error relative to fault position.

In cables high fault resistances are not relevant, the insulation breakdown being generally definitive, quickly developing to permanent solid fault. The cable version of the extended zero sequence circuit [13] can be easily developed on the basis presented here. In tests on a 3 feeders cable network of feeders' length (3.63; 4.84; 6.05)km, 10MVA total load, at 95...105% tuning and inception angles from  $0^\circ$  to  $90^\circ$ , we have got the fault position with average error less than 10% up to  $R_f=200\Omega$ .

### IV. CONCLUSION

Correct calculation of inception voltage assures good equivalence of new extended zero sequence circuit. This voltage takes into account the contributions of load currents on the fault-to-busbar segment of the faulty line. Applied in curve fitting procedures the new circuit permitted to push forward the parametrical limits in SLG fault location procedures.

### V. REFERENCES

- [1] A.G.Phadke, M.Ibrahim, T.Hlibka, "Fundamental Basis for Distance Relaying with Symmetrical Components", *Proc. IEEE Trans. Power Apparatus and Systems*, vol. PAS-96, n° 2, pp. 635-646, March/April 1977
- [2] J. Coemans, L. Philippot and J.-C. Maun, "Fault distance computation for isolated or compensated networks through electrical transient analysis", *Proc. Int. Power System Transients IPST 1993*, pp. 250-254
- [3] T. Welfonder, V. Leitloff, R. Feuillet and S. Vitet, "Location strategies and evaluation of detection algorithms for earth faults in compensated MV distribution systems", *IEEE Trans. Power Delivery*, vol. 15, n° 4, Oct. 2000, pp. 1121-1128
- [4] S.Hanninen and M.Lehtonen, "Earth fault distance computation with fundamental frequency signals based on measurements in substation


supply bay", VTT Research Notes, Espoo 2002, <http://virtual.vtt.fi> (URL)

- [5] T. Welfonder, "Localisation de défauts monophasés dans les réseaux de distribution à neutre compensé", PhD dissertation, LEG INPG Grenoble, France, 1998
- [6] J.C.Maun, L.Philippot, J.Coemans and M.Mouvet, "Power System Modelling for Design of Advanced Fault Locators and Line Protections", in *Proc. Stockholm Power Tech*, vol. IC, pp. 394-399, 1995
- [7] S.-J.Lee, M.-S.Choi, S.-H.Kang, B.-G.Jin, B.-S.Ahn, N.-S.Yoon, H.-Y.Kim and S.-B.We, "An intelligent and efficient fault location and diagnosis scheme for radial distribution systems", *IEEE Trans. Power Delivery*, vol. 19, n°2, pp. 524-531, April 2004
- [8] A.S.Al-Fuhaid and M.A.El-Sayed, "A recursive least-squares digital distance relaying algorithm", *IEEE Trans. Power Delivery*, 1988, pp. 1257-1263
- [9] S.Hanninen and M.Lehtonen, "Earth fault distance computation with ANN trained by neural voltage transients", *Proc. IEEE PES SM2001*, Vancouver, Canada, July 2001
- [10] G.Eberl, S.Hanninen, M.Lehtonen and P.Schegner, "Comparison of ANN and conventional algorithms in ground distance computation", *Proc. IEEE PES WM2000*, Singapore, 2000
- [11] S. Hanninen, M. Lehtonen, T. Hakola and R. Rantanen, "Comparison of wavelet and differential equation algorithms in earth fault distance computation", *Proc. 13<sup>th</sup> Power Systems Computations Conf. 1999*, pp.801-807
- [12] P.Ferraci, M.Meunier and L.Berthet, "An equivalent circuit for earth-fault transient analysis in resonant-grounded distribution power networks", *Proc. IPST'95*, International Conference on Power Systems Transients, Lisbon, 1995
- [13] W.Y. Huang, "Identification rapide des paramètres d'un défaut monophasé dans un réseau compensé de distribution sans mesure de tension", PhD dissertation, Supelec, France, 2006

### VI. BIOGRAPHIES



**Wan-Ying HUANG** has graduated from Tsing Hua University in Taiwan with Master Degree in 2002 and in 2006 has got her PHD in the Ecole Supérieure d'Electricité SUPELEC and University Paris XI in France. She is now on a post doctoral research program in SUPELEC, working on protections in distribution systems and optimal design of electric machines.



**Robert KACZMAREK** is professor in the Ecole Supérieure d'Electricité (Supelec) in France. His research interest is with power networks (fault detection, network protection, and parameters identification), magnetism (domain observation, loss prediction and measurements in soft and hard magnetic materials) and the design of electric machines